
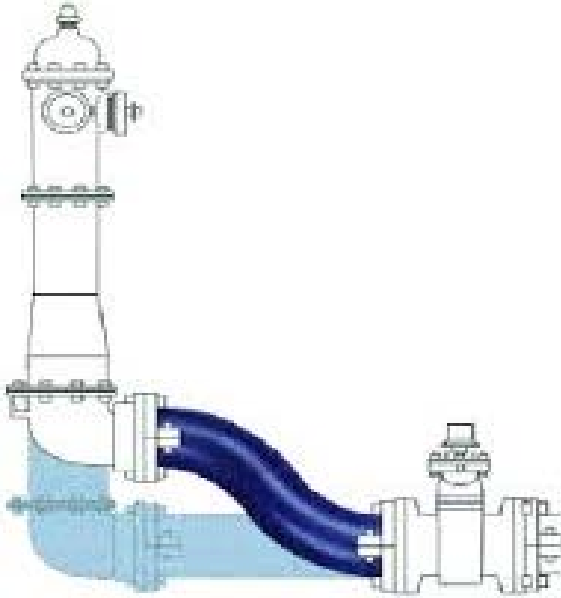


<div><p>CITY OF CAPE CORAL UTILITIES DEPARTMENT</p></div>	QUALIFIED PRODUCTS LISTING
	HYDRANT OFFSETS
	SPECIFICATION NUMBER
	15235. 2.2.B.
<p>MINIMUM REQUIREMENTS:</p> <p>15235. 2.2.B.</p> <p>In order to meet the required location and grade, hydrants may be installed using an offset device to provide vertical and horizontal adjustment to the final setting of the hydrant. Locator devices shall be used in all locations where offsets are placed. The hydrant offset shall be in accordance with AWWA C153/ANSI A21.53 Ductile Iron. The offset shall match the hydrant diameter center to center.</p> <p>The hydrant offset shall have an anchoring feature on both ends to provide a restrained joint.</p> <p>The hydrant offset shall be tar coated outside and cement lined inside per AWWA C104 to provide corrosion protection.</p>	
	PRODUCTS
	GRADELOK
	OR CITY APPROVED EQUAL
	THE USER IS SOLELY REPOSNSIBLE FOR ASSURING THAT HE/SHE USES THE MOST RECENT REVISION
	Revision Date: 1/19/2016
	Attachment List
	<div><div>Name</div><div>No records to display.</div></div>